


GRILLE & DIFFUSER SCHEDULE


SYM.	MANUFACTURER	MODEL NO.	SIZE	PATTERN	REMARKS
1	TITUS	272-FL5	42X16	22"	1
2		272-FL5	34X16	22"	UNDER ALTERNATE H-1
3		30" GL	18X18	2/4"	1
4		3FL	12X12	2/4"	1
5		TLC	7X9	2-WAY	1
6		TLC	7X12	2-WAY	1
7		3FL	24X24	2/4"	1

PAINT: WHITE PAINT: ENAMEL

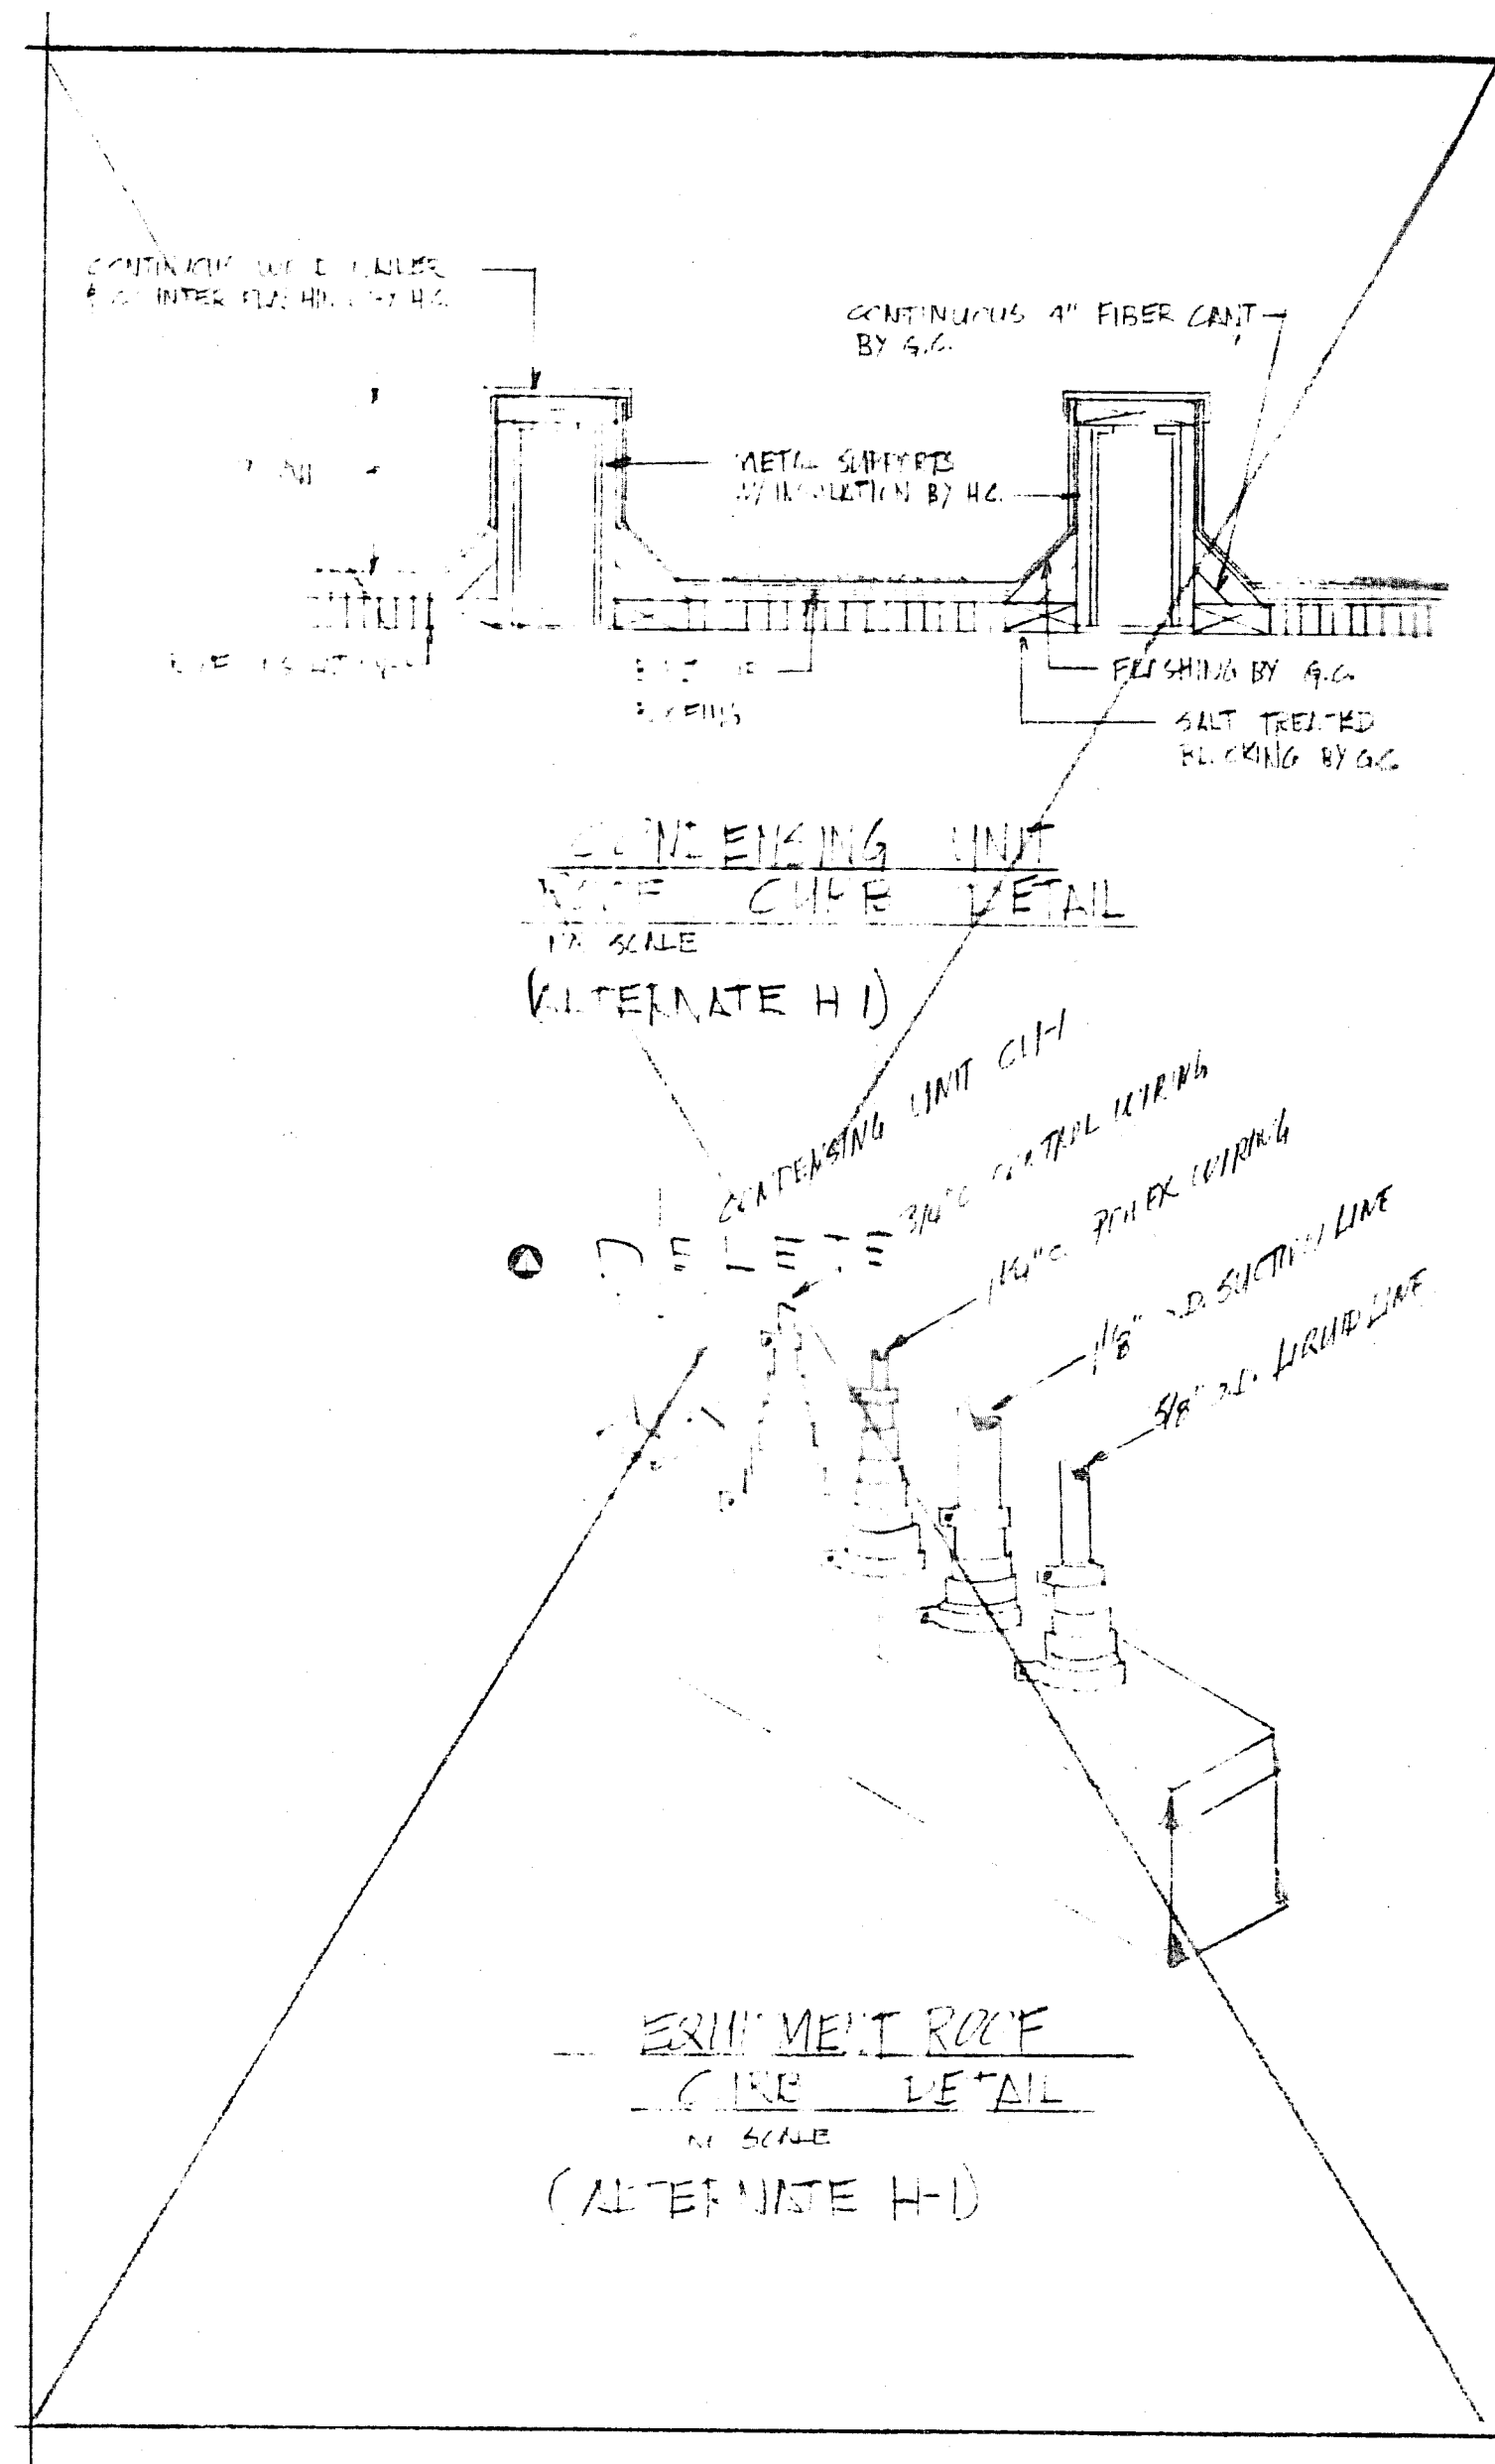


CONDENSING UNIT
PIPE CURB DETAIL
NO SCALE
(ALTERNATE H-1)


EXIT ROOF
CURB DETAIL
NO SCALE
(ALTERNATE H-1)

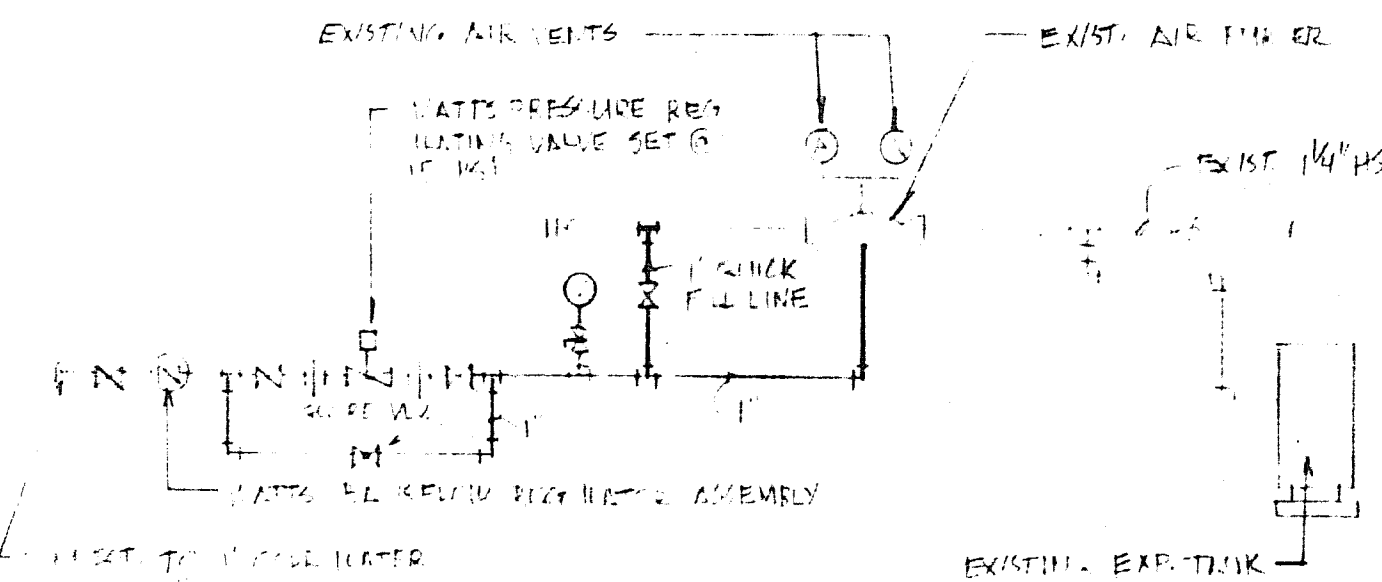


NEW AUTO FILL FOR EXIST. HW SYSTEM DETAIL
NO SCALE

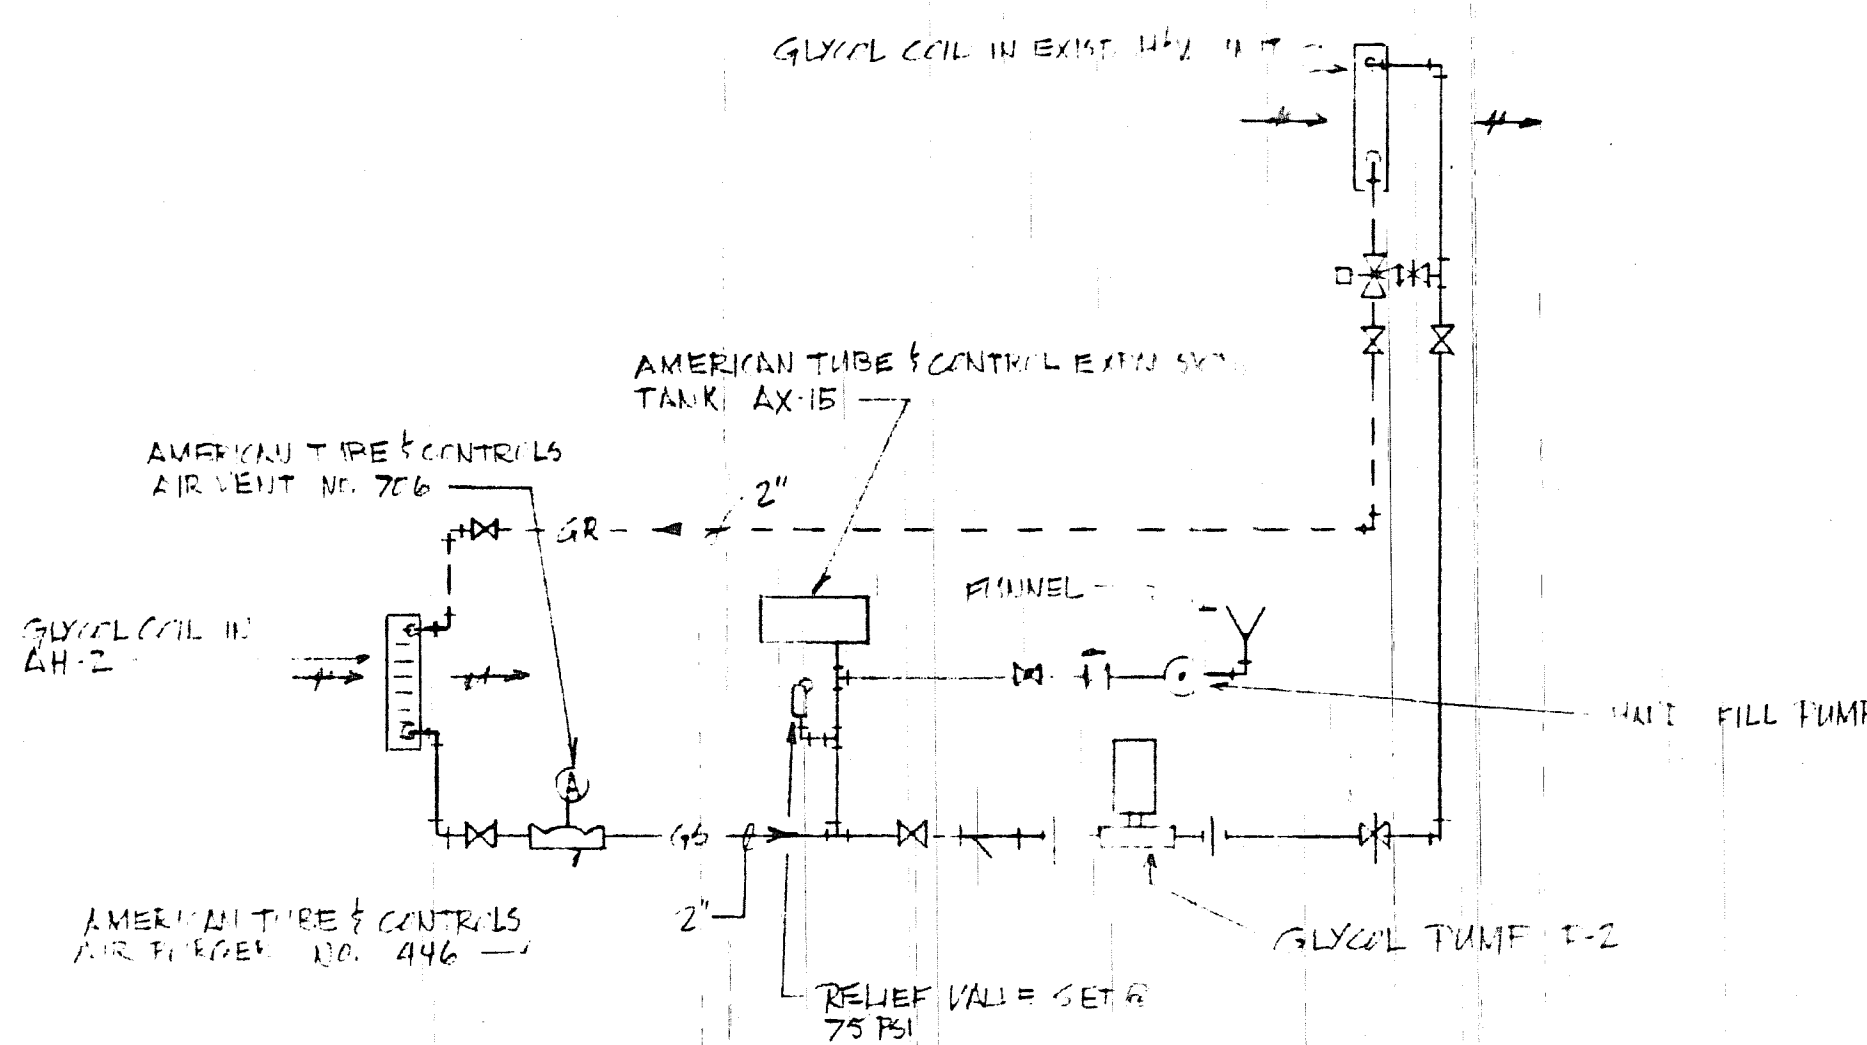


GLYCOL RUN AROUND LOOP PIPING DETAIL
NO SCALE
(ALTERNATE H-2)

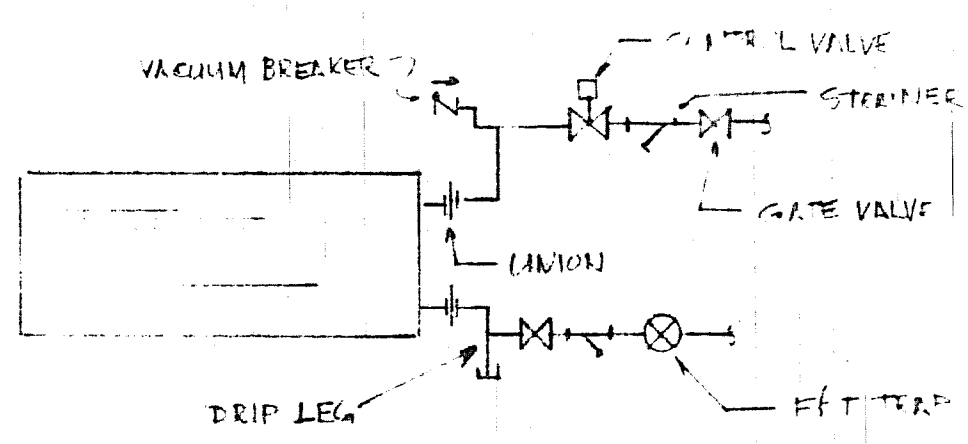

STEAM DUCT COIL FITTING DETAIL
NO SCALE
(ALTERNATE H-2)

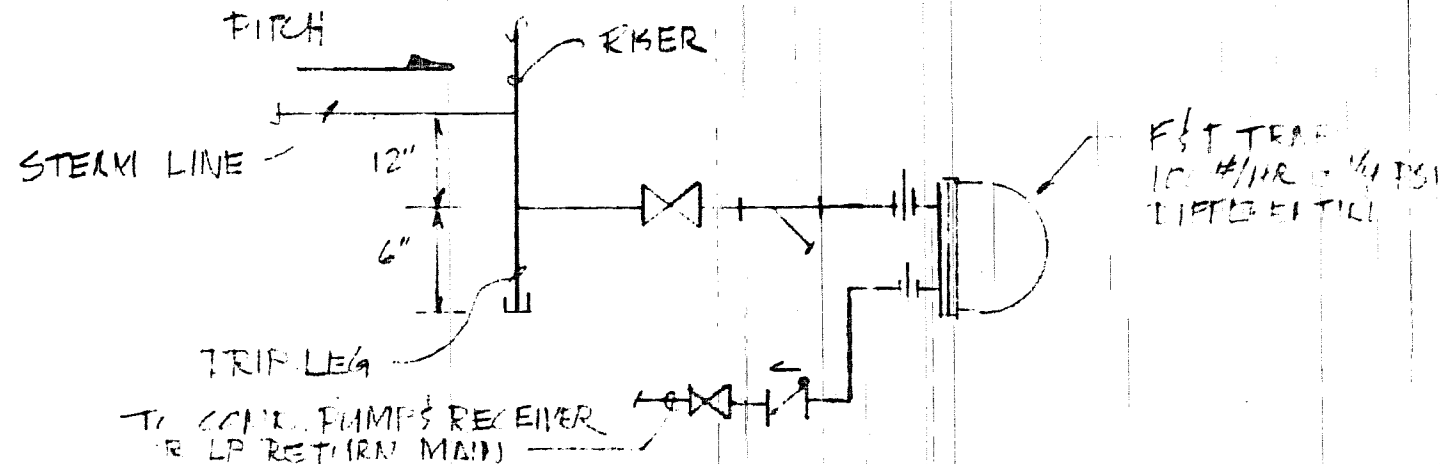

DRIFF LEG STEAM DETAIL
NO SCALE
(ALTERNATE H-2)

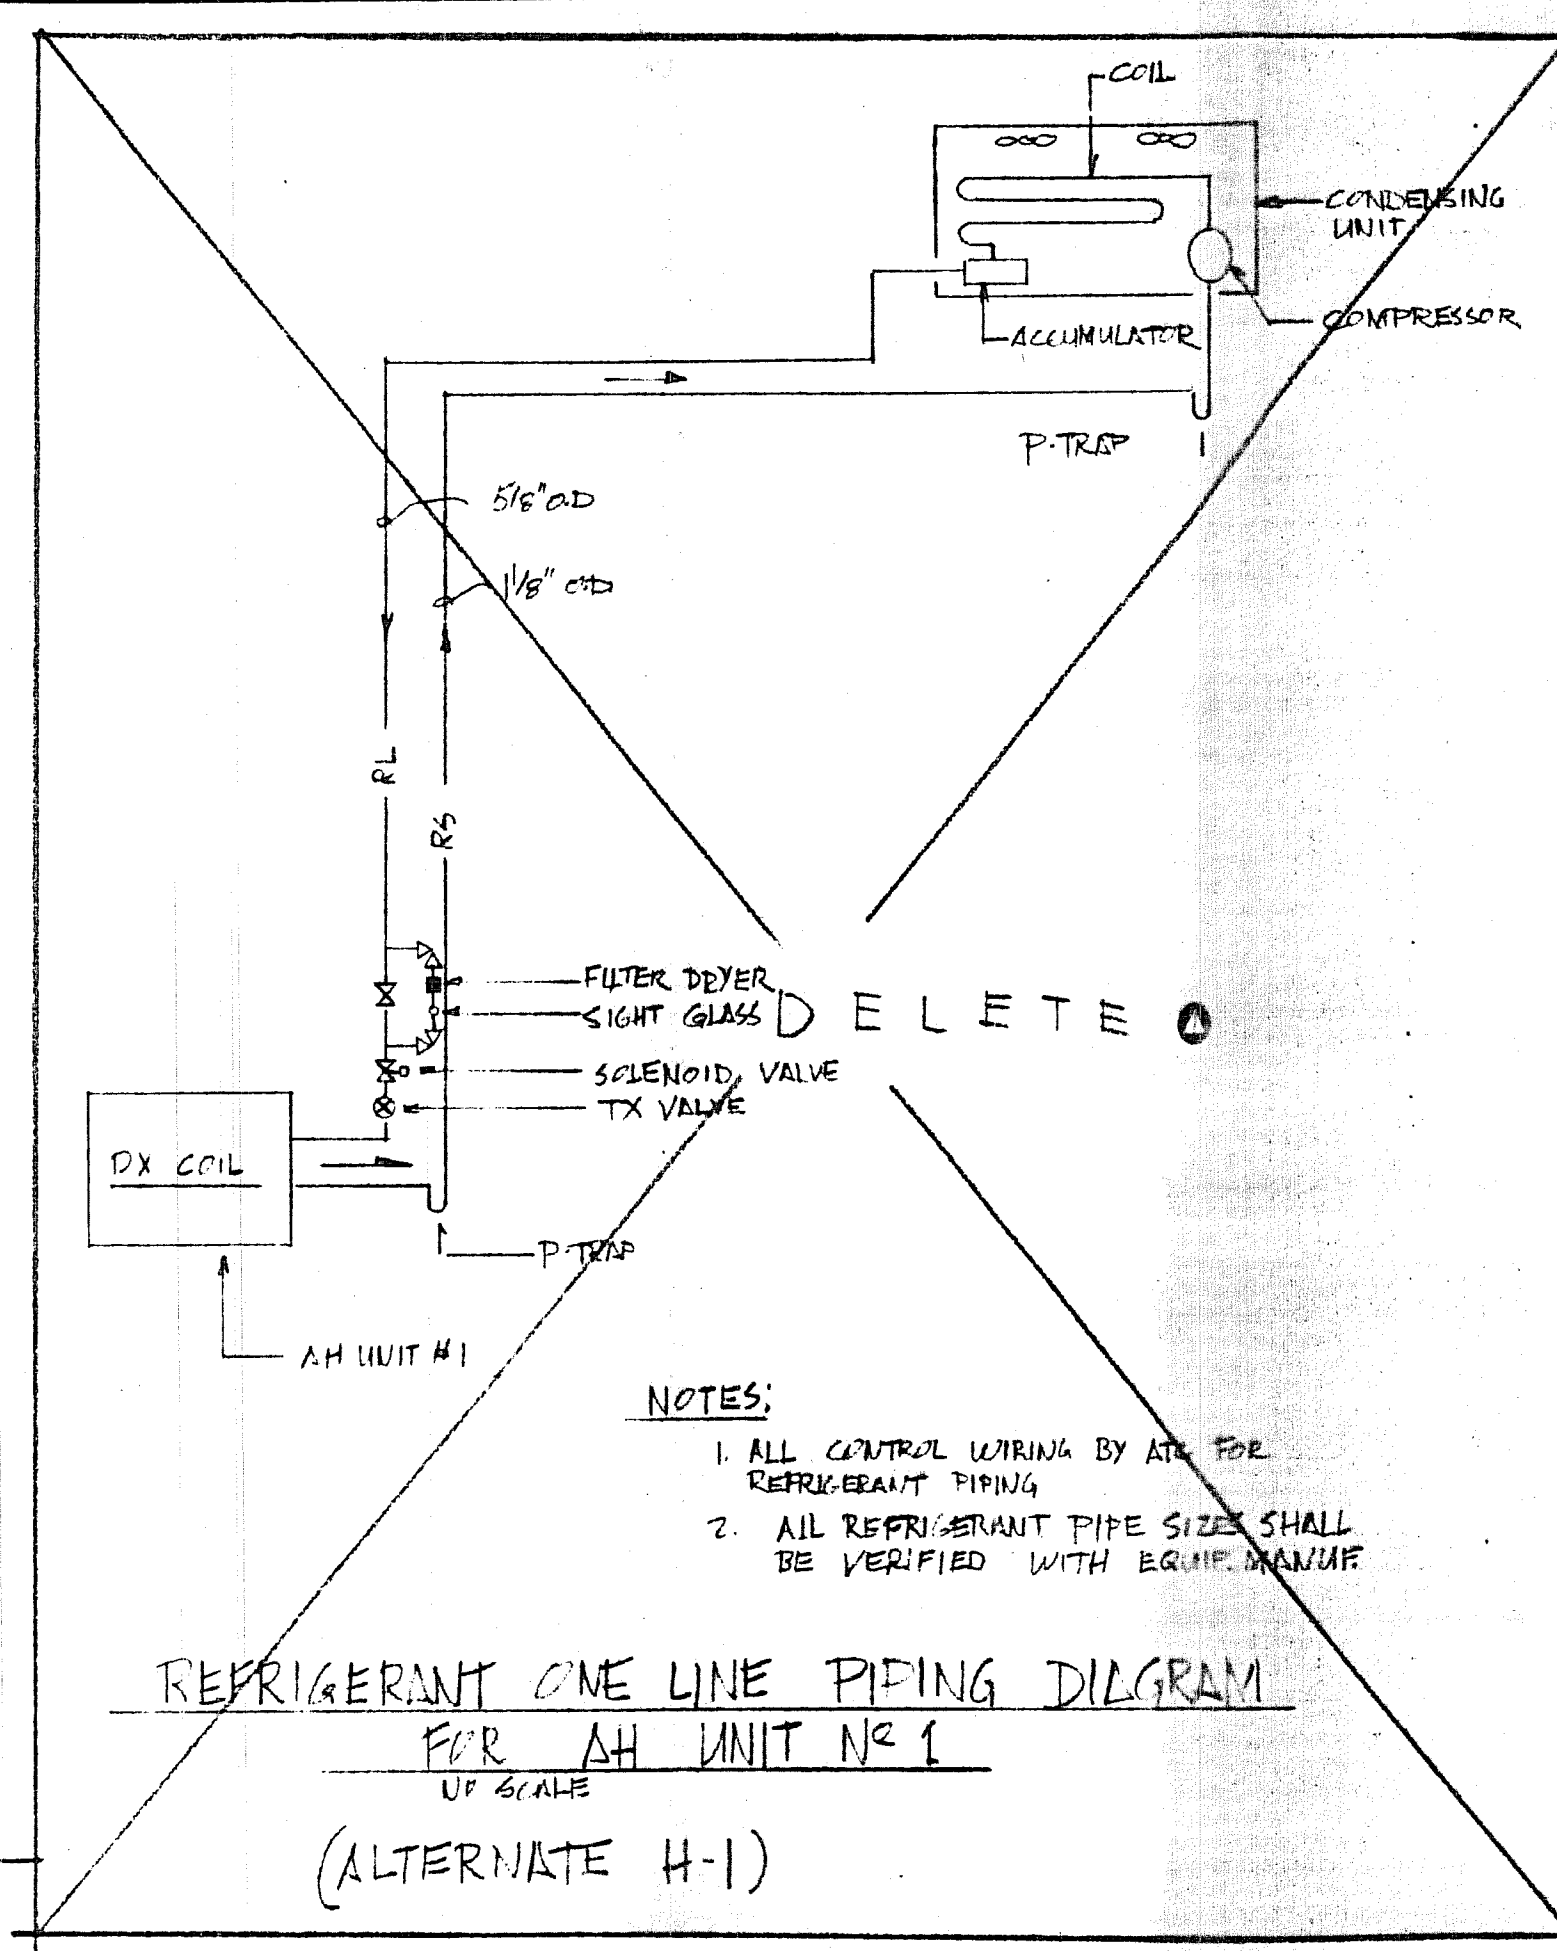

NOTES:
1. ALL CONTROL WIRING BY AIR FOR REFRIGERANT PIPING
2. ALL REFRIGERANT PIPE SIZES SHALL BE VERIFIED WITH EQUIV. MANUF.

REFRIGERANT ONE LINE PIPING DIAGRAM
FOR AH UNIT NO. 1
UP SCALE
(ALTERNATE H-1)

EQUIPMENT SCHEDULE

- (V) RELIEF VENT... ACME SKYMASTER TRIMLINE, 3640 CFM, .075\"/>

NO.	DATE	GENERAL REVISIONS
1	11/17/79	HVAC DETAILS & SCHEDULES
2	12/1/79	RACQUETBALL COURTS
3	12/1/79	UPPER BUCKS Y.M.C.A.
4	12/1/79	QUAKERTOWN BORO - BUCKS CO. - PENNSYLVANIA

DATE 9/19/79
SCALE AS NOTED
JOB NO. 600105
DWG. NO. H-2
OF 2